

THORITE - BLACKBURN

Unit 1, Forrest St, Blackburn.
BB1 3BB. UK.
Tel: +44 (0) 1254 679922
Fax: +44 (0) 1254 673285
blackburn@thorite.co.uk

THORITE - BOLTON

Raikes Lane Industrial Estate,
Bolton. BL3 2NH. UK.
Tel: +44 (0) 1204 362614
Fax: +44 (0) 1204 528765
bolton@thorite.co.uk

THORITE - BRADFORD

Thorite House, Laisterdyke,
Bradford. BD4 8BZ. UK.
Tel: +44 (0) 1274 663471
Fax: +44 (0) 1274 668296
bradford@thorite.co.uk

THORITE - DONCASTER

Whittingtons Court, Wheatley Hall
Road, Doncaster. DN2 4PE. UK.
Tel: +44 (0) 1302 325491
Fax: +44 (0) 1302 341007
doncaster@thorite.co.uk

THORITE - HUDDERSFIELD

6 Barge Street, Huddersfield.
HD1 3LN. UK.
Tel: +44 (0) 1484 534245
Fax: +44 (0) 1484 435023
huddersfield@thorite.co.uk

THORITE - LEEDS

Unit 4, Riverside Place,
Bridgewater Road, Leeds.
LS9 0RQ. UK.
Tel: +44 (0) 113 200 0640
Fax: +44 (0) 113 248 4855
leeds@thorite.co.uk

**HOGG PNEUMATIC SOLUTIONS -
NORTH SHIELDS**

Unit 4, Saturn Court, Orion
Business Park, North Shields.
NE29 7BY. UK.
Tel: +44 (0) 191 258 2623
Fax: +44 (0) 191 296 1445
sales@hoggpneumaticsolutions.co.uk

THORITE - ROCHDALE

Unit 11, The Landings, Oldham
Road, Rochdale. OL16 5QY. UK.
Tel: +44 (0) 1706 860919
Fax: +44 (0) 1706 861731
rochdale@thorite.co.uk

THORITE - SHEFFIELD

5 Barnforth Street, Sheffield.
S6 2HD. UK.
Tel: +44 (0)114 233 1128
Fax: +44 (0)114 233 1140
sheffield@thorite.co.uk



ENERGY **SAVING**



THE NORGREN GUIDE
to saving energy in compressed air systems

>> ENERGY SAVING IN COMPRESSED AIR SYSTEMS

COMPRESSED AIR IS OFTEN WRONGLY ASSUMED TO BE A CHEAP OR EVEN 'FREE' SOURCE OF POWER. **IT IS NOT.**

A typical 1,000 cfm (500 litres/sec) installation will consume £40,000 of electricity in a year. During its lifetime energy represents 75% of the total cost of buying and running a compressor. Numerous independent studies confirm that industry wastes around 30% of the compressed air it generates, equivalent to £12,000 in our typical 1,000 cfm installation. The aim of this guide is to help the end user minimise wastage, by improving existing installed systems. It will highlight key areas for savings, and offer practical advice on an action plan.

For further information or advice contact
Thorite at:
group@thorite.co.uk or call 01274 663471

>> LEAKAGE

Leakage is the major source of energy loss in compressed air systems. A typical plant may lose 20% of its compressed air through poorly connected pipe joints, fittings, couplings etc. Fixing the leaks and introducing planned maintenance can produce substantial savings.

>> MISUSE

The second major wastage of compressed air is to use it as a power source just because it is available. There may be better alternatives for moving, drying or cleaning products. Where compressed air is used, selecting correct equipment such as nozzles and use of control circuits can minimise wastage.

>> OVER PRESSURISATION

A considerable saving both in energy and equipment life can be made by using devices at the minimum pressure required for the application rather than full line pressure. Simple use of pressure regulators offers very fast payback.

>> PRESSURE DROP

Loss in pressure, due to blocked filter elements and undersized pipework, can mean pressure starvation at the end of compressed air lines. The guide shows examples of how to choose and maintain equipment to minimise pressure drop in systems.

>> ENERGY AND SAFETY

Components fitted for safety reasons, such as preset regulators and shut off valves, can also help energy saving. This section reviews relevant parts of BS EN 983 and other standards linking them to energy issues.

>> GENERATION

The correct selection of control equipment to multiple compressor set ups, attention to inlet cooling and after treatment of the compressed air can realise good energy savings. Regular and correct maintenance of compressors, filters and dryers is also vital.

>> ACTION PLAN AND FURTHER INFORMATION

A simple checklist for action and sources of further information.

>> APPENDIX CHARTS

>> HOW TO USE THIS GUIDE

The process of air preparation has been the core of Norgren's business for over 70 years. The guide reviews each of the major opportunities for energy saving so that you can take practical measures in your own plant.

Each section covers:

- Where to look for savings
- What to note or measure
- How much does it cost?
- What are the solutions?
- How do we maintain good practice?

Throughout the guide you will find detailed examples of how to calculate the savings potential indicated by. These are based around a model factory

EXAMPLEENGINEERING, which has many of the problems commonly found in compressed air systems.

EXAMPLEENGINEERING

The factory has installed compressor capacity of 1,500 cfm (750 litres/sec), and an average demand of 1,000 cfm (500 l/s). It operates 24 hours per day, 7 days per week, for 50 weeks a year. Electricity costs 10p/kWh. At 75% compressor utilisation, total cost is £78,400 per year.

The basis for most of the calculations is the "wastage formula".

This costs flow at:

$0,4 \times \text{hours} \times \text{flow l/s} \times \text{energy cost/kWh}$.


At EXAMPLEENGINEERING, typical leakage is 20% and equals 100 l/s, which costs:

$0,4 \times 8,400 \times 100 \times \text{£}0.10 = \text{£}33,596$.

The calculation examples in this guide are based on one section of the factory, the workshop area.

The workshop operates for 2,500 hours per year, but the ring main is pressurised all the time the factory is open. The total savings identified equal 30% of the air currently used by the workshop area.

WORKSHOPAREA

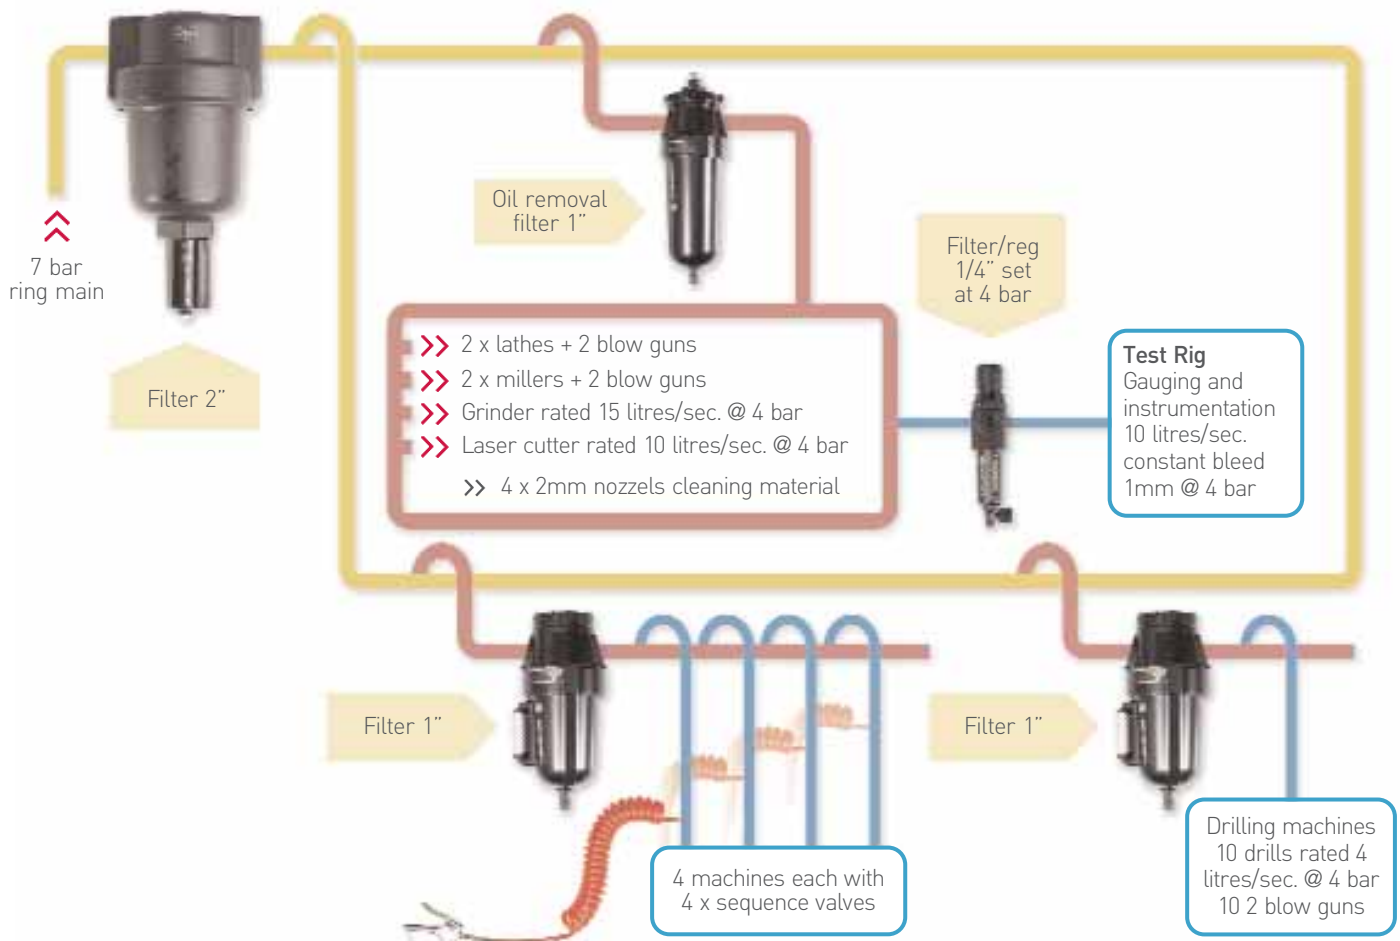

>> LEAKAGE

Leaks can be a significant source of wasted energy in an industrial compressed air system.

If compressed air were hydraulic fluid, leaks would be so visible that we would ensure their reduction. As it is we accept a low level hiss in our work places as 'part of the job'

At a price which is roughly comparable to that of domestic gas, this attitude costs industry dearly.

It is estimated that leaks cost UK industry £20m per annum.

In addition to being a source of wasted energy, leaks can also contribute to other operating losses. Leaks cause pressure loss in systems, which can mean pressure is too low to the application leading to more reject product. Frequently the generation capacity is increased to compensate, rather than simply fixing the leaks.

WHERE TO FIND LEAKS

LEAKS OCCUR EVERYWHERE!

>> PIPEWORK

Ageing pipework is a prime source of leaks. Replace any corroded pipework sections - for safety as well as energy saving.

>> FITTINGS, FLANGES AND MANIFOLDS

Large leaks are often found at connection points, both in the main distribution system and in off takes. Sometimes when several snap connectors are used together to form manifolds they can be a source of leakage due to worn connectors and poorly jointed pipe work.

>> FLEXIBLE HOSES AND COUPLINGS

Leaks can be caused by damage to hose due to abrasion by surrounding objects, deterioration of the hose material and strain on the joint because the hose is too long or too short.

>> OLD COMPONENTS NOT MAINTAINED - SEALS START TO LEAK

Check all pneumatic components eg old cylinders and regulators, for worn internal air seals which can cause large leaks.

>> CONDENSATE DRAINAGE VALVES

Large amounts of air can be lost when drain valves are stuck open or even left open intentionally. These can often be found in remote parts of the system where condensate collects.

>> SYSTEMS LEFT PRESSURISED WHEN NOT IN USE

Where subsystems have a large amount of leakage which cannot be avoided eg. presses and drop hammers, isolate them from the air supply when not in use. Simple shut-off valves (figure 2), or electrically operated soft start dump valves (figure 3) offer cost effective ways to isolate leaky systems, or areas of a plant when not in use.



Figure 2.
Manual shut-off valve.

MEASURING THE LEAKAGE

You can measure the base leakage easily using one of several methods

>> Install a flowmeter and pressure transducer in the compressed air feeding main (after any receivers). Connect the output of the flowmeter and the pressure transducer to a chart recorder and take readings over a representative period of time. Measure the flow from the compressor when the system is not working eg at a weekend.

>> Use a compressor of known capacity to pump the system up to normal operating pressure during non production hours. The compressor will unload at the operating pressure. As the system pressure drops due to leakage the compressor will load at its minimum running pressure. You can then estimate the leakage rate from the average loaded and unloaded times over a representative period.

>> Pump the system up to pressure and measure the time taken for the pressure to decay to the lower limit. If you know the total volume of the piping network and the receivers, you can calculate the leakage rate.

Use a small flowmeter in branch lines to identify real problem areas.

But is it worth it ?

How much do leaks really cost ?



Figure 3. Soft start dump valve will also isolate equipment, preventing leaks.

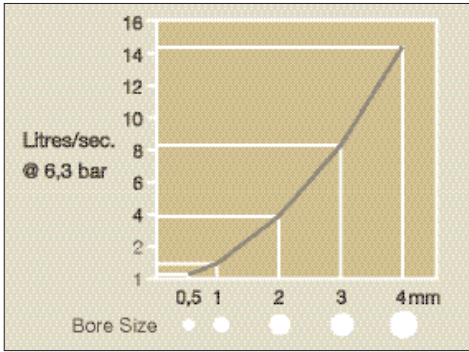


Figure 4. Leakage rate for different hole diameters.



Figure 5. Leakage can be from any joint and is easily shown by spotleak.

WHAT DOES IT COST?

A single leak from a hole diameter 2mm can cost £600 per year, in our workshop example. Use orifice flow chart (figure 19 in the appendix chart section) to calculate leakage at different bore sizes and pressures.

REDUCING LEAKAGE

Set targets for leakage reduction. Publicise how much money the leakage is costing the organisation and how much you intend to save. Implement an ongoing maintenance programme - have 'leak' tags available and encourage their use.

Carry out a survey of the compressed air system. Inspect during quiet hours. Listen for pipework or tool leaks and examine hoses and couplings. Spray 'spotleak' on pipe joints and watch for bubbles.

The average leak will take around half a man hour to fix, and offer very quick payback.

Fixing the leaks will clearly save significant amounts of money, but how do we make sure they stay fixed?

Implementing a site-wide awareness programme leads to long term savings on a big scale.

Dividing the site into areas, fitting air consumption meters and charging each area for its air usage will soon focus the attention of energy users. Targets can then easily be set to reduce energy loss due to leaks.

LEAKAGE

After surveying the workshop area a number of leaks were found:

1 x 2mm leak @ 4 bar
and 11 x 1mm leak @ 7 bar

Using the orifice flow table, that equates to 4,8 l/s and 11 x 1,2 l/s

Total leaks = 18 l/s

POTENTIAL FOR SAVING

$0,4 \times 8,400^* \times 18 \times \text{€}0,10 = \text{€}6,048$

* assumes system stays pressurised for 24 hours per day, 50 weeks per year.

COST OF SOLUTION

Estimate 1/2 a man hour to fix each leak
@ €20.00 per hour = **€120.00**

| Savings | Expense | Nett saving |
|------------------|----------------|------------------|
| €6,048.00 | €120.00 | €5,928.00 |

>> MISUSE

The second major wastage of compressed air is to use it as a power source just because it is available.

Some examples of this are inefficiently creating vacuum, ejecting faulty products and removing water/dirt/powder from products. There may be better alternatives for these applications. If compressed air is chosen the correct equipment and control must be employed to keep usage to a minimum.



Figure 7. Blow gun with air saver nozzle.

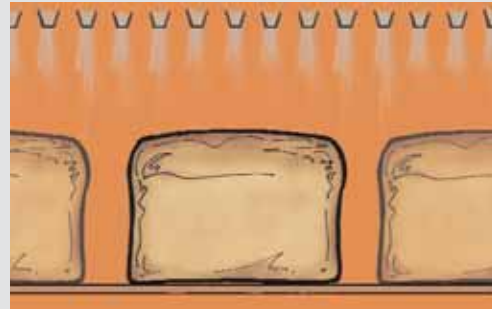


Figure 6. Example of poor practice. Nozzle should be closer to the bread and of an air saver design. A control circuit is needed to stop air when no bread is under the nozzles. Consider local filtration and membrane dryer for high quality dry air.

WHERE TO FIND MISUSE

In an existing plant new misuses can often be seen by an increase in air demand and/or compressor running hours. To identify existing misuses all areas of the plant need to be surveyed, asking the question - is this an effective use of air?

COSTING THE MISUSE

Where a process has air passing to atmosphere, such as rejection of under weight or faulty product in a canning process, a flowmeter can be installed in the line to measure the air usage. Then by using the wastage formula the cost of this process can be found.

RECOMMENDED PRACTICE

Another way to calculate costs is to use the exit orifice or nozzle diameter and the applied pressure to calculate the flow [see table, figure 19 orifice flow, appendix chart section].

Where nozzles must be used, for example blowing loose flour off loaves of bread (fig 6), then ensure that the distance between the exit nozzle and the product is as short as possible as this will allow the supply pressure to be reduced. The nozzle should be directed only at the area needed giving a cone (circular area) or fan spray (long narrow band) etc. Where a very long narrow area needs to be covered use nozzles in parallel to produce a curtain reducing the distance to the furthest point. Ensure the mains feed line to a number of nozzles is of sufficient diameter so as not to restrict the outlet flow.

Air saver nozzles entrain and accelerate air within their mechanism to produce the desired outputs with reduced supply pressures, giving savings of up to a twenty fold reduction in compressed air usage (fig 7).

Finally where such solutions must be used ensure control valves and sensors are fitted to the system, so that flow only occurs when the product is at the application point, with no flow during the gaps between product on the conveyor, or at work breaks etc. In some cases the solution is not to use compressed air. Dedicated air blowers or vacuum pumps may well prove more cost effective.

All such solutions can be costed and compared to the air usage/wastage and in almost every case savings can be made. Once misuse has been determined within a plant, ensure that when new processes are installed due consideration is given to the power source and controls are in place.

MISUSE

Material is cleaned prior to being cut by the laser using 4 x 2 mm at line pressure.

| | |
|-------------------------|-----------------------|
| 4 x 2 mm nozzle presets | 4 x 4,8 l/s at 7 bar |
| | 4 x 1,81 l/s at 2 bar |

Using the orifice flow table, figure 20.

So a reduction in pressure to 2 bar will give a flow saving of 11,96 l/s.

POTENTIAL FOR SAVING

$0,4 \times 8,400^* \times 11,96 \times \text{€}0,10 = \text{€}4,017$

* assumes no isolation valves and system is continually pressurised.

COST OF SOLUTION:

Fit one pressure regulator = £18.00

Estimate 1/2 a man hour @ £20.00 per hour = £10.00

Total **£28.00**

| | | |
|------------------|---------------|------------------|
| Savings | Expense | Nett saving |
| £4,017.00 | £28.00 | £3,989.00 |

>> OVERPRESSURISATION

Many systems run at full line pressure with the only control being the pressure switch on the compressor. Every item of pneumatic equipment has an optimum operating pressure and flow. Usage outside of these conditions will shorten the equipment life due to increased loading and wear, and will increase the running costs. A device running at 7 bar will consume twice as much air as it would at 3 bar.

IDENTIFYING OVERPRESSURISATION

The absence of pressure regulators in a system indicates that equipment is being used at excessive pressures. Savings can be realised in many areas, including air tools, control valves, clamping cylinders and on the return stroke of large double acting cylinders.

Where pressure regulators are present but outlet pressure is the same as the inlet, this often indicates poor lubrication with extra pressure being applied to overcome the friction slowing down the process. This is costly in extra wear and energy.

CALCULATING THE COSTS

All **air tools** are rated for their flow and optimum pressure. The air wastage can be calculated by using the pressure ratio (absolute), and then multiplying by the rated air flow i.e. consumption at 3 bar is 8 l/s at 7 bar this will be

$$\frac{[7 + 1]}{[3 + 1]} \times 8 = 16 \text{ l/s}$$

This can then be substituted into the annual wastage formula to calculate savings.

Double acting cylinders usually only do work on the out stroke (work stroke). When no work is being done or longer reset times are possible, the return stroke can be at a lower pressure. Where large bore, long stroke or multiple cylinder systems exist, considerable air savings can be made. Using a regulator to reduce return stroke pressure can be a fast payback solution. Consumption with reduced pressure return stroke for double acting cylinder can be measured using the formula

$$\text{Air saving} = \frac{0,7854 \times d^2 \times L (P1 - P2) \times 10^{-6}}{T \times 60}$$

d = cylinder diameter (mm)

L = stroke length (mm)

T = time for 1 stroke (sec)

P1 = applied pressure (bar) - outstroke

P2 = applied pressure (bar) - return stroke



Figure 8.
Set the pressure to the air tool at rated setting, not mains pressure.

Valves have a rated conductance C in litres/sec per bar absolute. Any flow saving is calculated by simply reducing the applied pressure. It is important to note the valve operating duration (i.e. time that flow occurs) to ensure that the correct flow saving is arrived at. Usually this figure is small but for multiple valve installations and/or rapidly cycling valves with long pipe runs the total saving can be significant.

Once over pressure examples have been identified within a factory, ensure that all new plant, processes and equipment are examined for optimum operating conditions and pressure control equipment prior to installation. This should be reflected in increased tool life as well as reduced energy costs.

OVER PRESSURISATION

10 air tools rated @ 4 bar.

These drills are all supplied with 7 bar line pressure, and each is used on average for around 1,000 hours per year.

The air consumption of each drill at 4 bar is 15 l/s. therefore at 7 bar each tool will be consuming:

$$8 \times 15 = 24 \text{ l/s}$$

So by using a lower pressure there is a potential saving of 9 l/s per tool.

Over the total 2,500 hours of annual usage, the average flow saving = $\frac{1,000}{2,500} \times 9 = 3.6 \text{ l/s}$

POTENTIAL FOR SAVING

$$0,4 \times 2,500 \times 3,6 \times \text{€}0,10 = \text{€}3,377$$

COST OF SOLUTION:

Fit one pressure regulator per tool = €25 x 10 = €250
1/2 man hour for fitting @ €20 per hour = €10 x 10 = €100
Total **€350**

* calculations need to be done with absolute pressures – i.e. 1 bar higher than reading

| | | |
|------------------|----------------|------------------|
| Savings | Expense | Nett saving |
| €3,377.00 | €350.00 | €3,027.00 |

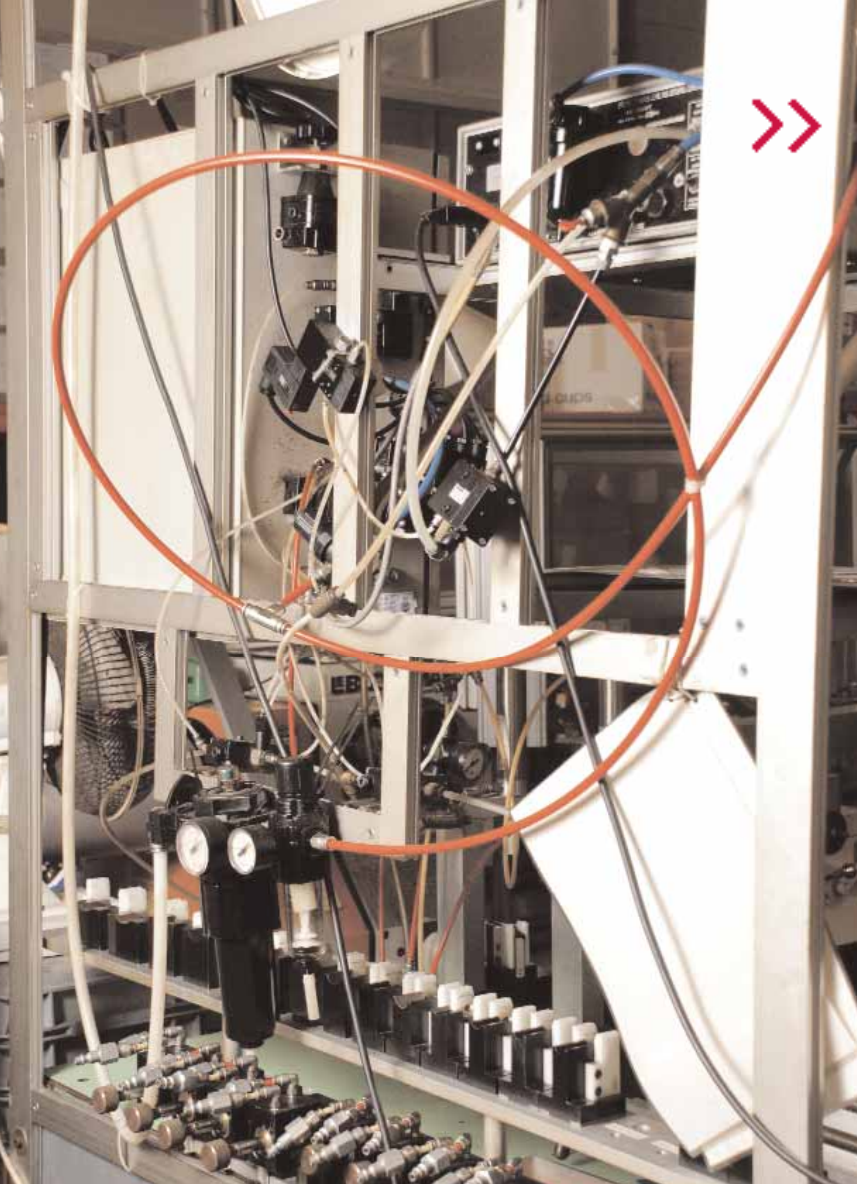


Figure 9. Example of poor pipework on a production test rig.

PIPEWORK

Pressure drop occurs in pipework mainly as a result of friction of the air molecules with the surface of the pipe. If the pipe is too small for the volume of flow the velocity of the air will be very high and there will be a big loss in power. Energy is also lost when there is a change in flow direction i.e. elbows, junctions and shut off valves. Simple pipe systems will minimise pressure drop (fig 9).

How to calculate pressure drop in pipework:

Method 1

- Measure supply pressure.
- Measure the pressure at furthest point from supply.
- The difference is the system pressure drop.

Method 2

- Estimate the flow usage - eg. calculate the swept volume of working cylinders.
- Note the supply pressure and the diameter of the pipe.
- Use published normographs to arrive at the pressure drop.

Method 3

- Use a small flowmeter to measure the flow.
- Note the supply pressure and the diameter of the pipe.
- Use figure 22 in tables to see whether flow is within recommended range.

PRESSURE DROP

Pressure drop can be defined as 'the loss in a system of power available to do work'. In practice it is shown by low pressure in parts of the system. It is often compensated for by increasing generation pressure or turning up regulators. The potential energy generated by compressing the air is dissipated through friction and heat losses as it is pushed through all the components of the system.

We need therefore to design and maintain systems to minimise the amount of pressure drop. Every 1 bar of unnecessary pressure drop leads to an increase of 7% in generating costs. This means around £3,500 per annum to our typical factory.

The two main areas where pressure drop occurs are pipework and filtration.

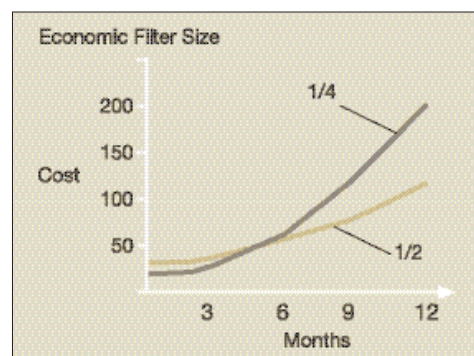


Figure 10. Selecting the right size filter is important.

RECOMMENDATIONS

Don't over flow the pipework. Keep velocity below 6 m/s in mains. Simplify the pipework. Avoid elbows as a 90 degree elbow is equivalent to 1.6 m of straight pipe.

Fit 'low resistance' valves; a full flow ball valve equates to 0.4 m of pipe, less than half the resistance of a gate valve. Figure 21 in tables shows examples.

FILTRATION

Filtration is an essential part of the conditioning in a compressed air system. If not protected from water, particles and degraded compressor oils, machines will quickly breakdown.

To keep pressure drop as small as possible:

Look for the right size filter unit

As with pipework if the filter unit is too small for the flow required then it will give a higher pressure drop. When new a general purpose filter should give no more than 0,1 bar pressure drop. Fitting a smaller filter is a false economy, as it will give higher initial pressure drop and also block more quickly because the surface area of the element is smaller (fig 10).



Figure 13. Filters with integral pressure drop indication.

Look for the right level of filtration

A very fine filter will have a greater resistance to flow than a coarse filter. Most air tools for example will only require filtration to around 40 micron. It makes sense therefore not to use a 5 micron or even a 0,01 micron filter in this application (fig 11).

Where applications needing higher grade filtration exist, place the higher grade filters as close to the application as possible. This ensures that the size of filter determined by the flow is as small as possible. Do not filter the whole of the air line or branch line to this standard, since this will increase the flow requirement, increasing the size of the filter, its purchase price, replacement element price and incur extra pressure loss for the whole of the system downstream of it.

Look for dirty filter elements - check pressure drop indicators

After some time in service, particles will be trapped within the filter media causing the element to become blocked. This means pressure is lost at the application. What usually happens at this stage is that the pressure is increased to compensate by turning up a regulator. Increasing the pressure increases the costs.

An extra 0,35 bar of pressure drop in a line can cost as much as £400 per year.

Fitting pressure drop indicators - simple pneumatic or electrical (fig 13) can indicate immediately when pressure drop is increasing. Changing the elements at this point means significant energy saving.

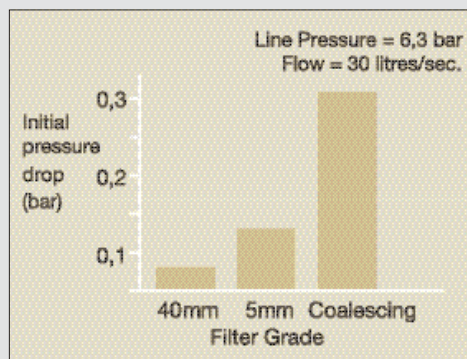


Figure 11. The effect of filter grade on pressure drop.

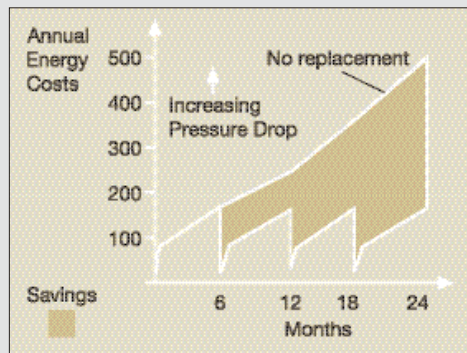


Figure 12. Cost saving through regular element changes.

It is good practice to change the filter elements at regular intervals. This will ensure that energy wastage is kept to a minimum and that correct air quality is delivered (fig 12). Any new plant should be installed with the right level of air quality in mind - instrument quality only where the application demands it.

Delivering very dry high quality air to all areas of the site is costly and should be avoided.

PRESSUREDROP

A 2" filter flowing 400 l/s @ 7 bar when new, pressure drop = 0,15 bar in 2 years this could increase to 0,4 bar This extra 0,25 bar creates an extra power demand of 1,8 Kwh.

POTENTIAL FOR SAVING

For 2,500 hours total extra power =
1,8 x 2,500 Kwh @ £0.10 per Kwh extra cost = £450.00

COST OF SOLUTION:

| | |
|---|---------------|
| Replace filter element | = £70.00 |
| 1/2 a man hour labour @ £20.00 per hour | = £10.00 |
| Total | £80.00 |

| | | |
|----------------|---------------|----------------|
| Savings | Expense | Nett saving |
| £450.00 | £80.00 | £370.00 |

>> ENERGY & SAFETY

How can Safety be an Energy Issue ?

In compressed air systems components fitted for valid safety reasons have a cost. However there are some that offer a payback resulting from the benefits gained in energy savings. There are several documents that deal with safety of compressed air systems and pneumatic components. Some are international standards whilst others though not having legal status, offer best practice guidance from safety organisations and leading fluid power trade organisations.

BS EN 983 - LEAKS

'Leaks (internal or external) shall not cause a hazard'. In systems where air pressure is used to maintain a load, such as in a press, braking or clamping application, a leak could potentially constitute a hazard.

BS EN 983 - FILTRATION

'Filter condition monitoring. If deterioration of filter performance could lead to a hazardous situation, clear indication should be given'. A blocked filter, leading to reduced downstream pressure could have a similar effect to a leak in systems where the pressure is used to maintain loads. Pressure drop indicators will show when the filter is blocking and needs changing. This also minimises energy costs by keeping pressure drop to an acceptable level.

BS EN 983 - TAMPER RESISTANT DEVICES

'Pressure and flow control devices or their enclosures shall be fitted with tamper resistant devices where an unauthorised alteration to pressure or flow can cause a hazard'. Frequently, pressure is increased to machines or systems in the hope that the increase will speed up the process. Usually there are other factors within the system which will limit this and increasing the pressure will only increase the air consumption. In some cases, increasing the pressure can be unsafe such as when using pneumatic clamps. The force generated is calculated to clamp the component; any increase in that force may result in crushing of the component which may shatter or explode. Simple tamper evident covers, which can be padlocked, can be fitted to regulators to ensure systems remain safe (fig14). Lockable shut off valves prevent someone accidentally turning off the air to a system, or turning on the air while a machine is being maintained creating a potential hazard.

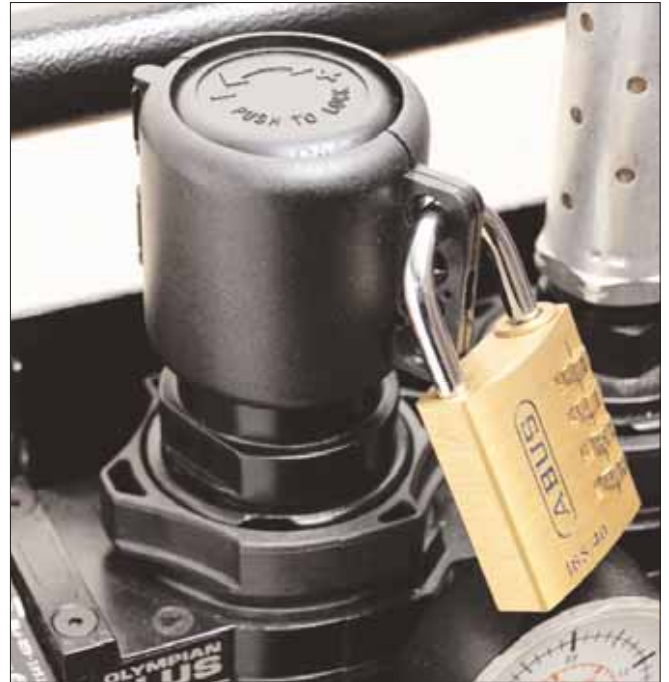


Figure 14. Use of a lockable tamper evident cover on a filter/regulator.

BS EN 983 - SOFT START DUMP VALVES

Machines should be designed so that at start up any moving components reach their working position in a safe manner. There must also be a safe way of releasing the system air very quickly when signalled. Combined soft start dump valves achieve both these functions in one unit. They also have the added benefit that the signal can be linked to one power down operation which will isolate the machine when not in use. This means any leaks or constant bleed devices will not drain the main system.

HSG 39 - CORRECT USE OF BLOW GUNS

'Blow guns, consisting simply of a reduced orifice in direct line with the supply hose, can be extremely dangerous, unless preceded by a pre-set tamperproof pressure regulator set at a reduced pressure from the normal 80 psi air line supply.' Blow guns are commonplace throughout industry and whilst most people are familiar with their use, the very real hazards they present are often not appreciated. As an example a pressure of 0,4 bar can penetrate human skin with possible fatal results if air gets into the bloodstream. Many blow guns are operated at full line pressure and can even be 'home made' i.e. short pieces of copper tube with diameters up to 6 mm. This situation is clearly dangerous. A secondary concern is the sheer volume of air that is wasted. Good practice would be a blowgun with built in side



Figure 15. Pre-set tamper proof regulator for Blowguns.

vents to prevent pressure build up if the nozzle becomes blocked, preceded by a small preset non adjustable regulator (see figure 15).

If reduced pressure presents problems with an operation such as cleaning swarf from a component, then blow guns with efficient nozzles can be used to entrain some atmospheric air. This equipment will provide a safe working situation with the added benefit that it will pay for itself very quickly in reducing air usage.

BS 6005 - 1997 SAFETY OF POLYCARBONATE BOWLS

Polycarbonate is commonly used for bowls on filters, filter-regulators and lubricators, offering clear visibility of bowl contents. However, in an industrial environment it needs to be treated with some care. The standards says: A.4.1.2 'Bowls which on visual inspection show signs of mechanical damage, cracking, or hazing should be replaced'.

A.4.1.3 'Bowls which have been contaminated with paint should also be replaced; they should not be cleaned'.

A.4.1.4 'All bowls which have been in service for 10 years should be replaced, even though they may appear acceptable by the visual inspection mentioned in A.4.1.2'

Whilst changing bowls which have any of the above problems will not directly save energy, it should be included in a maintenance plan which also checks the condition of filter elements and drains to reduce pressure drop and leaks.



Figure 16. Typically aged units still working on a CNC machine.

Filters are notorious for being badly maintained and it is important to raise awareness of the safety implications of neglect of these units (fig 16).



Figure 17. Lockable shut-off valve

POWER - ISOLATION FROM AIR SUPPLY

Regulation 19 'Every employer shall ensure that where appropriate work equipment is provided with suitable means to isolate it from its sources of energy'.

A variety of valves are available to help meet this requirement:

- ball valves (fig 17)
- shut off valves included in FRL units
- electrical operated control valves
- pneumatically operated control valves

Use of these has the added benefit that any leakage in the system downstream will not be continually draining the mains air supply.

AIR FUSE

The use of air fuses can also have an effect on energy saving. The device is designed to prevent pneumatic hoses whipping around, exhausting high pressure air in the event of a hose fracture. The fuse reduces the flow to atmosphere, so that only a very small amount of air escapes, compared to full line failure flow. Danger of injury from the hose is eliminated and energy wastage is minimised.

In situations where isolating valves and air fuses do not exist, it would be necessary to bleed down the system, wasting all the compressed air before the hose failure could be repaired.

ENERGY&SAFETY

18 blow guns with 4 mm hole, supplied with 7 bar line pressure.

Blow guns should be regulated to a lower pressure using the orifice flow table:

Flow through 4 mm @ 7 bar = 19 l/s

Flow through 4 mm @ 2 bar = 7 l/s

Potential flow saving per gun = 12 l/s

Gun is used for 300 hours per year (around 10 minutes in every hour)

Average saving per year = $300 \times 12 = 3,600$ l/s

Total for 18 blow guns = 25 l/s

POTENTIAL FOR SAVING

$0,4 \times 2,500 \times 25 \times \text{£}0.10 = \text{£}2,500.00$

COST OF SOLUTION:

18 preset regulators = £450.00

1/2 man hour to fit each = £180.00

Total = £630.00

| | | |
|------------------|----------------|------------------|
| Savings | Expense | Nett saving |
| £2,500.00 | £630.00 | £1,870.00 |



Typical large compressor house with multiple compressors

GENERATION

At best only 5% of the input energy to an air compressor remains in the air after it is compressed. This is due to the heat rejected by the compressor in its cooling systems.

Most compressor locations will contain the compressor, the treatment system and the control system. Each element of the compressor station, the installation and its maintenance has an effect on energy efficiency.

HEAT RECOVERY

Use the waste heat of compression for space heating, domestic water heating or process water. Large savings can be achieved by doing this.

MAINTENANCE

The way compressors are looked after in the field has a major impact on generation efficiency. Machines should always be maintained strictly in accordance with the manufacturers instruction book.

It is a false economy to run rotary vane and screw units past the manufacturer's recommended compression element life cycle. Typically this is 24,000 hours with oil-injected machines and 40,000 hours for oil free machines.

Regularly inspect the intercooler pressure on two stage piston and screw compressor. This should be around 2 to 2,5 bar when the final discharge pressure is 7 bar. Any deviation shows stage imbalance giving poor efficiency. Similarly check the pressure drop across the oil separator system.

If the maintenance of your compressor is conducted by a third party firm, make sure you use a manufacturer's accredited agent. Only use genuine spare parts; items which are not of the original design or poorly refurbished will have a serious effect on energy efficiency. A small apparent saving in these areas can give a false economy in the long term.

CONTROL

Where a number of compressors, possibly of different types and sizes are used to meet varying air demands, then a control system should be employed. This will optimise the number and mix of compressors to meet the demand, giving close pressure control with the most energy efficient mix of machines.

TREATMENT

Only treat the air to the minimum standard required. Refrigerated air dryers giving +3°C dewpoint and filters add 3% to the energy cost. Desiccant air dryers and filters giving -40°C dewpoint add between 8 and 15% to the running costs.

Use desiccant or membrane dryers at the point of use to save energy. Use dewpoint sensing controls with desiccant dryers. Keep treatment system pressure losses to 0,5 bar. Size filters for the maximum flow, do not allow reduced flange sizes. Maintain filters regularly. Figure 23 in tables show the relative costs of treatment.

OPERATING PRESSURE

Establish the minimum acceptable pressure at the point of use and ensure the piping network is designed such that the pressure drop with the system on full load does not exceed 0,5 bar.

If possible, reduce the generation pressure. A reduction of 1 bar can save 7% of the generation cost. Reduced pressure also reduces the unregulated air demand of the plant. A reduction from 8 bar to 7 bar will reduce the unregulated demand by around 12%.

COMPRESSOR SIZE AND CONFIGURATION

The size and configuration of compressor is important in terms of energy efficiency.

Depending on the demand pattern, it is normal to have the largest and most efficient machine on line to handle the base load and other machines coming on and off line to meet changes in demand.

Most modern installations use rotary compressors of the oil injected vane and screw types. When higher quality and larger volumes of air are needed, oil free screw or centrifugal machines can be used and these usually have better efficiencies. (See figure 20)

Although not so popular for new applications, unless they are for special gases or high pressure, there are many piston machines still in operation. These machines particularly in the larger sizes have excellent efficiency and part load control. Variable speed drives are becoming quite common as are two stage oil injected machines.

INSTALLATION

Cooling is most important with all compressors. The inlet air should be as cool as possible, ideally taken from a shaded outside location. In general a 4°C reduction in inlet temperature will give an improvement of 1% in efficiency.

A simple check on a compressor's health is to measure the differences in temperature between the cooling medium and the discharge air from the aftercooler.

For air-cooled compressors this should not exceed 15°C.

For water-cooled compressors this should not exceed 10°C.

If greater temperature differences are found the machines' efficiency will be lower than design. The cooling systems should be improved.

Make sure all the feeding mains are correctly designed with flow velocities not greater than 6 metres per second. Use swept tees and long radius elbows at all pipe junctions.

Use electronic level sensing traps on all condensate collection points and ensure condensate recovery conforms to the regulations.

ACTION PLAN

» Measure System Flow Demand:

Survey Factory In 3 Areas:

- compressor house
- ring main
- bays/point of use

Focus In Each Area On:

- leaks
- misuse
- over pressure
- pressure drop
- safety issues

then locally measure usage if possible

Having Identified Areas for Savings:

cost out corrective action and

- payback
- implement
- check/flow pressure drop to validate
- measure

Use Revised Flow Figures to Modify Control System for Compressors where necessary

Implement Ongoing Preventive Maintenance and Periodic Re-audit (Leaks Come Back)

FURTHER SOURCES OF INFORMATION



Clean Compressed Air Norgren's Guide to Effective Air Preparation

ETSU PUBLICATIONS

ETSU the energy efficiency branch of the Department of Environment Transport and Regions, offer a range of free publications on all aspects of energy saving. For compressed air information refer to:

Good Practice Guides

- 216 Energy Saving in the Filtration and Drying of Compressed Air
- 238 Heat Recovery from Air Compressors
- 241 Energy Savings in the Selection, Control and Maintenance of Air Compressors

Good Practice case studies

Carbon Trust 0800 085 2005.

Energy consumption guides

- ECG040 Compressing Air Costs:- Generation
- ECG041 Compressing Air Costs:- Leakage
- ECG042 Compressing Air Costs:- Treatment

OTHER PUBLICATIONS

- HSG 39 Compressed Air Safety
- BS 6005 1997 Specifications for Moulded Transparent Polycarbonate Bowls used in Compressed Air Filters and Lubricators
- PUWER Provision and Use of Work Equipment Regulations 1998
- BS EN983 - 1996 Safety of machinery - safety requirements for fluid power systems and their components - pneumatics
A European Norm standard that supports the essential health and safety requirements of the European Machinery Directive. It identifies hazards which affect the safety of systems and their components when put to their intended use. It is not a manufacturing standard so does not give guidance in the manufacturing of pneumatic components.

www.envirowise.gov.uk

www.energy-efficiency.gov.uk

>> APPENDIX CHARTS

Figure 19.

ORIFICE FLOW CHART

| Orifice Size (hole) | litres/sec - ANR (dm ³ /s) | | | | |
|---------------------|---------------------------------------|--------|--------|--------|--------|
| (mm) | 2 bar | 4 bar | 6 bar | 7 bar | 8 bar |
| 0.2 | 0.02 | 0.03 | 0.04 | 0.05 | 0.06 |
| 0.3 | 0.04 | 0.05 | 0.10 | 0.11 | 0.12 |
| 0.5 | 0.11 | 0.19 | 0.26 | 0.30 | 0.39 |
| 1.0 | 0.45 | 0.73 | 1.05 | 1.20 | 1.35 |
| 1.5 | 1.02 | 1.70 | 2.37 | 2.69 | 3.05 |
| 2.0 | 1.81 | 3.05 | 4.20 | 4.80 | 5.40 |
| 3.0 | 4.00 | 6.77 | 9.46 | 10.81 | 12.16 |
| 4.0 | 7.27 | 12.04 | 16.82 | 19.16 | 21.67 |
| 5.0 | 11.35 | 18.83 | 26.32 | 30.00 | 33.82 |
| 6.0 | 16.34 | 27.16 | 37.82 | 43.32 | 48.65 |
| 8.0 | 29.16 | 48.15 | 67.30 | 76.90 | 86.50 |
| 10.0 | 43.32 | 75.30 | 105.10 | 120.10 | 135.10 |
| 15.0 | 102.10 | 169.90 | 236.60 | 269.90 | 304.00 |

Figure 20.

COMPRESSOR EFFICIENCIES

| Configuration | Capacity litres/sec | Specific Power Kw ¹ /50 l/s | Part Load Efficiency |
|------------------------------------|---------------------|--|----------------------|
| Lubricated piston | 2-25 | 24 | Good |
| | 25-250 | 20 | Good |
| | 250-1,000 | 17 | Excellent |
| Oil-free piston | 2-25 | 26 | Good |
| | 25-250 | 22 | Good |
| | 250-1,000 | 19 | Excellent |
| Oil injected rotary vane and screw | 2-25 | 24 | Poor |
| | 25-250 | 22 | Fair |
| | 250-1,000 | 19 | Fair to good |
| Oil-free toothed rotor and screw | 25-250 | 20.5 | Good |
| | 250-1000 | 18 | Good |
| | 1,000-2,000 | 18 | Good |
| Oil-free centrifugal | 250-1,000 | 21 | Good |
| | 1,000-2,000 | 18 | Excellent |
| | Above 2,000 | 17 | Excellent |

Figure 21.

FRICION LOSS IN PIPE FITTINGS IN TERMS OF EQUIVALENT METRES OF STRAIGHT PIPE

| | 8mm | 10mm | 15mm | 20mm | 25mm | 32mm | 40mm | 50mm |
|------------------------|------|------|------|------|------|------|------|------|
| Tee (straight through) | 0,15 | 0,15 | 0,21 | 0,34 | 0,46 | 0,55 | 0,67 | 0,92 |
| Tee (side outlet) | 0,76 | 0,76 | 1,01 | 1,28 | 1,62 | 2,14 | 2,47 | 3,18 |
| 90° elbow | 0,43 | 0,43 | 0,52 | 0,64 | 0,79 | 1,07 | 1,25 | 1,59 |
| 45° Elbow | 0,15 | 0,15 | 0,24 | 0,30 | 0,38 | 0,49 | 0,58 | 0,73 |
| Ball valve* | 0,01 | 0,03 | 0,09 | 0,12 | 0,15 | 0,22 | — | — |

* Self exhausting – full open

Figure 22.

MAXIMUM RECOMMENDED FLOW * THROUGH ISO 65 MEDIUM SERIES STEEL PIPE.

| Applied Gauge Pressure bar | Nominal Standard Pipe Size (Nominal Bore) – mm | | | | | | | | | | |
|----------------------------|--|-----|------|------|-----|-----|-------|-------|-----|-------|-------|
| | 6 | 8 | 10 | 15 | 20 | 25 | 32 | 40 | 50 | 65 | 80 |
| | Approximate Pipe Connection – inch | | | | | | | | | | |
| | 1/8 | 1/4 | 3/8 | 1/2 | 3/4 | 1 | 1 1/4 | 1 1/2 | 2 | 2 1/2 | 3 |
| 0,4 | 0.3 | 0.6 | 1.4 | 2.6 | 4 | 7 | 15 | 25 | 45 | 69 | 120 |
| 1,0 | 0.5 | 1.2 | 2.8 | 4.9 | 7 | 14 | 28 | 45 | 80 | 130 | 230 |
| 1,6 | 0.8 | 1.7 | 3.8 | 7.1 | 11 | 20 | 40 | 60 | 120 | 185 | 330 |
| 2,5 | 1.1 | 2.5 | 5.5 | 10.2 | 15 | 28 | 57 | 85 | 170 | 265 | 470 |
| 4,0 | 1.7 | 3.7 | 8.3 | 15.4 | 23 | 44 | 89 | 135 | 260 | 410 | 725 |
| 6,3 | 2.5 | 5.7 | 12.6 | 23.4 | 35 | 65 | 133 | 200 | 390 | 620 | 14085 |
| 8,0 | 3.1 | 7.1 | 15.8 | 29.3 | 44 | 83 | 168 | 255 | 490 | 780 | 14375 |
| 10,0 | 3.9 | 8.8 | 19.5 | 36.2 | 54 | 102 | 208 | 315 | 605 | 965 | 14695 |

*Air flow rates in dm³/s free air at standard atmospheric pressure of 1,013 mbar.

General notes

The flow values are based on a pressure drop (DP) as follows:

10% of applied pressure per 30 metres of pipe

6 – 15 mm nominal bore inclusive

5% of applied pressure per 30 metres of pipe

20 – 80 mm nominal bore inclusive

Figure 23.

ADDITIONAL COSTS FOR TREATING COMPRESSED AIR

| Pressure Dew-point °C | Dryer Type | Filtration | Added Cost Over Generation | Initial Cost |
|-----------------------|--------------------|-----------------|----------------------------|--------------|
| Typical 10 | Membrane | Pre | 10 - 15% | Low |
| 3 | Refrigerated | General purpose | 3% | Medium |
| -40 | Heatless desiccant | Pre and after | 8 - 15% | High |
| -40 | Heated desiccant | Pre and after | 10 - 15% | High |
| -70 | Heatless desiccant | Pre and after | 15 - 21% | High |